
.....

.....

.....

.....


.....


.....

.....

10KV 500KV

Ň Ň

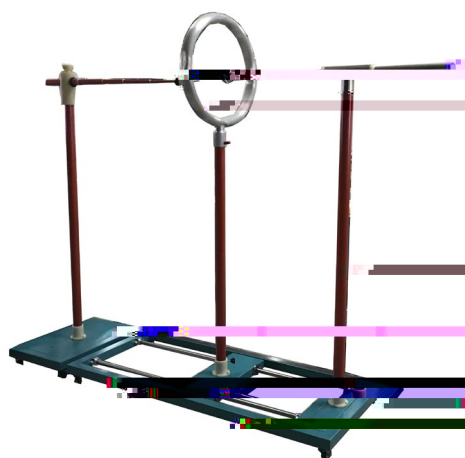

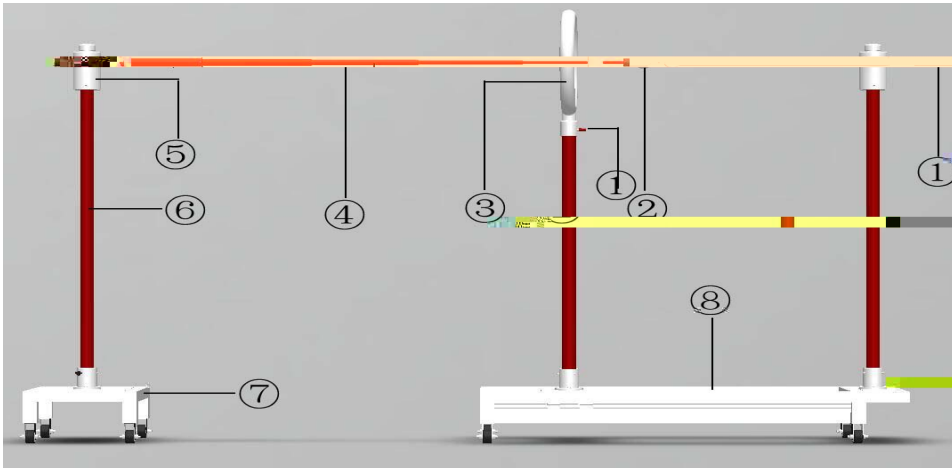

Ÿ

Ž



ž


Ž

ž

Ž

ž

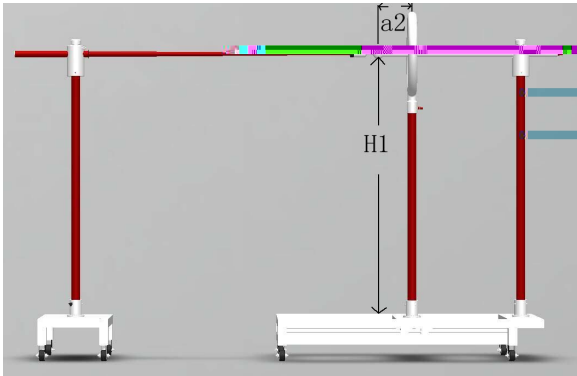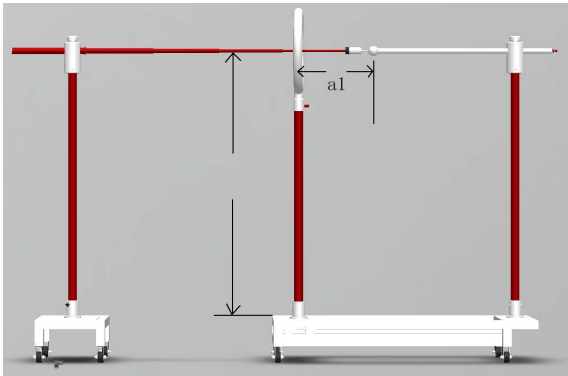

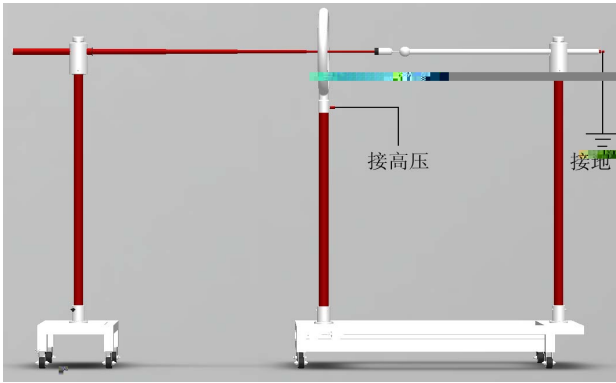

1 ч

III

2 ч

3 ч

III

1		2
2		3
3		1
4		4
5		1
6		